



Email: Kristofer.lopez@colliercountyfl.gov

Telephone: (239) 252-8944

Addendum 2

Date: May 7, 2019

From: Kristofer Lopez, Procurement Strategist

To: Interested Bidders

Subject: **Addendum #2:** Solicitation # 19-7590 SCRWTP Belt Filter Press Replacement


The following clarifications are issued as an addendum identifying the following clarification to the scope of work, changes, deletions, or additions to the original solicitation document for the referenced solicitation:

Addition:

1. This addendum is only answering the question from Bidsync. On page 2 of the addendum is the drawing for clarification

There are two control panels, the main panel in the control room and a local panel at the belt filter press. The local panel called out in Specification Section 115620 2.4.J is referred to as Control Station

(CS) on Sheet E-102.

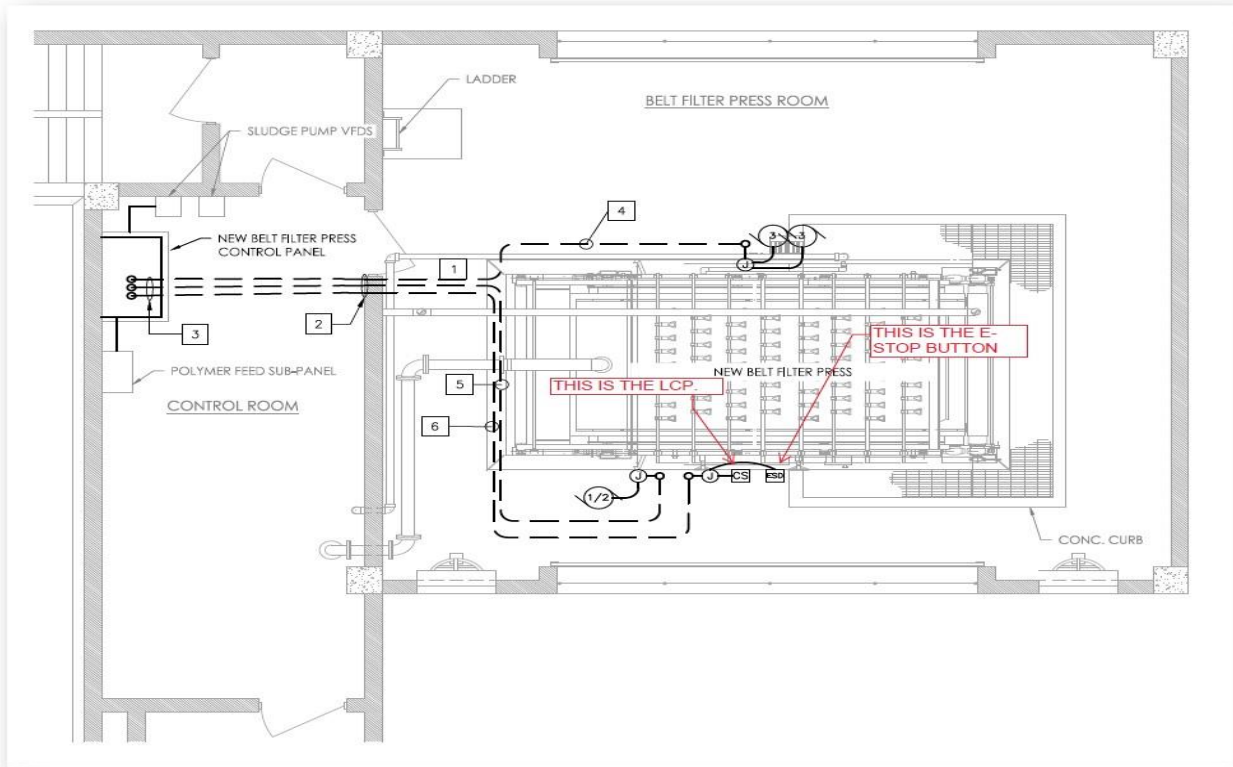

C: Alicia Abbott, Project Manager

Please sign below and return a copy of this Addendum with your submittal for the above referenced solicitation.

(Signature)

Date

(Name of Firm)