



City of Marco Island

April 15, 2025

Re: Addendum #1 ITB 2025-015

South Water Treatment Plant Odor Control Rehabilitation

Unless specifically stated, conditions in this Addendum are hereby made part of the Contract Documents, and the Bidder further agrees that the Proposal includes all impacts resulting from said Addenda. Receipt of this addendum must be acknowledged in the returned Bid Package.

1. **Could you please clarify what 'blower outfall to be replaced on Scrubber A' refers to in this context?** Correction: the outflow blower pipe must be replaced on Degasser B not A. It should be installed horizontally, without a 90% bend. The picture below shows the outflow pipe with a bend, which is incorrect.





City of Marco Island

2. **Do you have any pictures of the interior of the degasifier both prior to and following the repair?** Yes, the City has pictures from the interior of Degasifier A taken when the media collapsed in 2024. The pictures show the support, grading, and beams that were damaged. See attached pictures in the document.
3. **Please provide the control schematic/logic for all control panels to be replaced.** A picture of the control panels is shown below, and the control logic plans are attached to this document.



4. **Are we replacing the sound wall on all four sides, as indicated in the drawings, or only on the two sides currently in place?** Replace only the two sides that are currently installed.
5. **What is the Engineer's Estimate or construction budget?** The City has allocated a budget of \$1,000,000.00 for this project.

**Please do not forget to note the receipt of this addendum on *Form A*.
Declaration Statement.**

Best regards,

Angela Johenning


Angela Johenning


Purchasing and Risk Manager

Tel: (239) 389-5011

Email: AJohenning@cityofmarcoisland.com

SWTP Degasifier A - Pictures of the interior after the collapsed (2024)

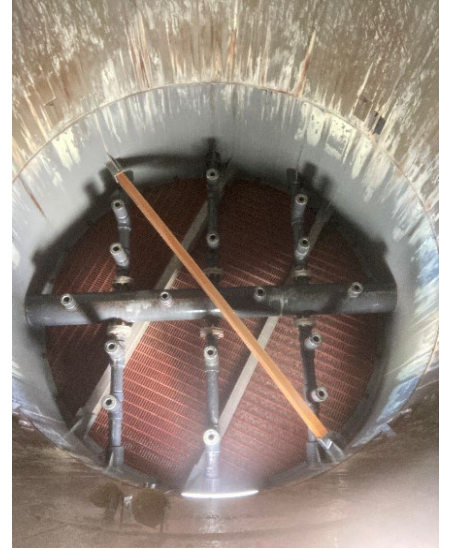


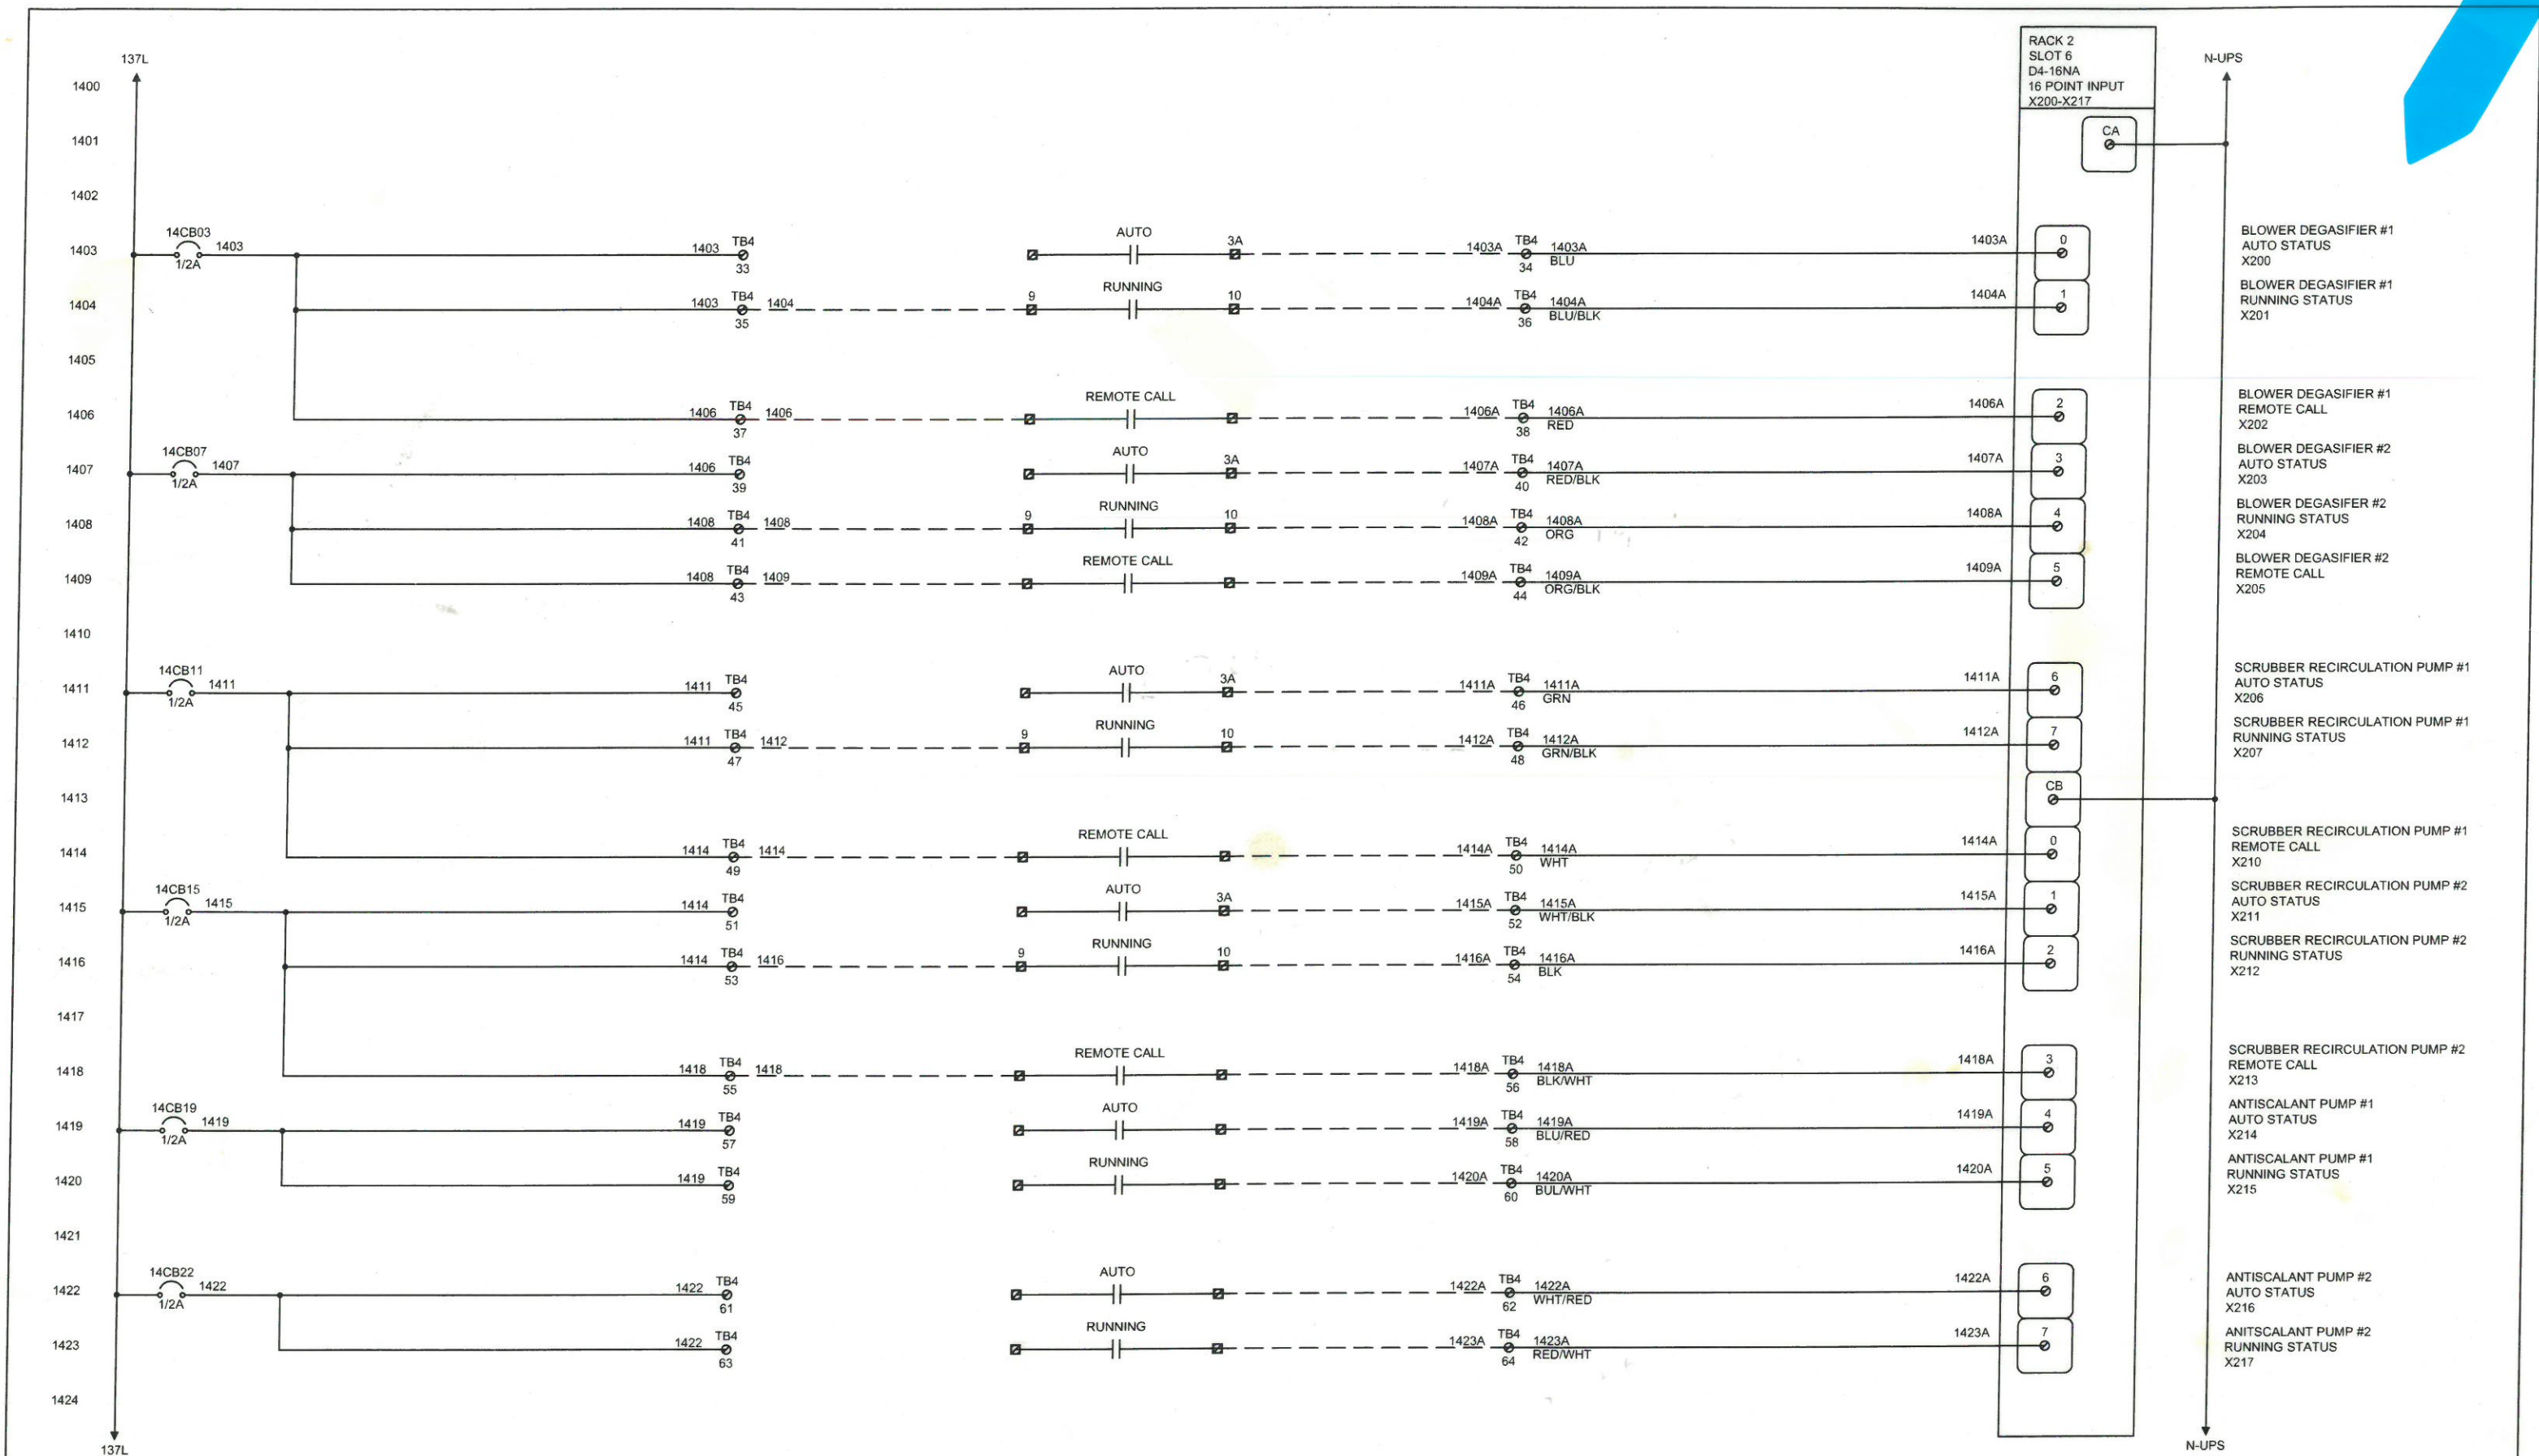

5/5/2010		FOR SUBMITTAL	PEN	
7/23/2010		DRAWING MODIFICATION	PEN	
DATE	REVISION		BY	CHK'D

The information, specifications and data contained in this drawing are furnished by and are to remain the property of BCI Technologies. The acceptor warrants that no use will be made of the same except to facilitate the installation, maintenance and operation of the equipment represented by said drawing.

TOLERANCES (UNLESS OTHERWISE SPECIFIED)		CUSTOMER: CITY OF MARCO ISLAND	
TITLE: WATER TREATMENT PLANT IMPROVEMENTS - MAIN PLC MAIN PLC DISCRETE INPUT MODULE 2			
SCALE:	DRAWN BY: PEN	CHECKED BY:	APP'D BY:
DATE: 5/5/2010	SHEET	OF SHEETS	DRAWING NO. 10145-MAIN-EE-014-01

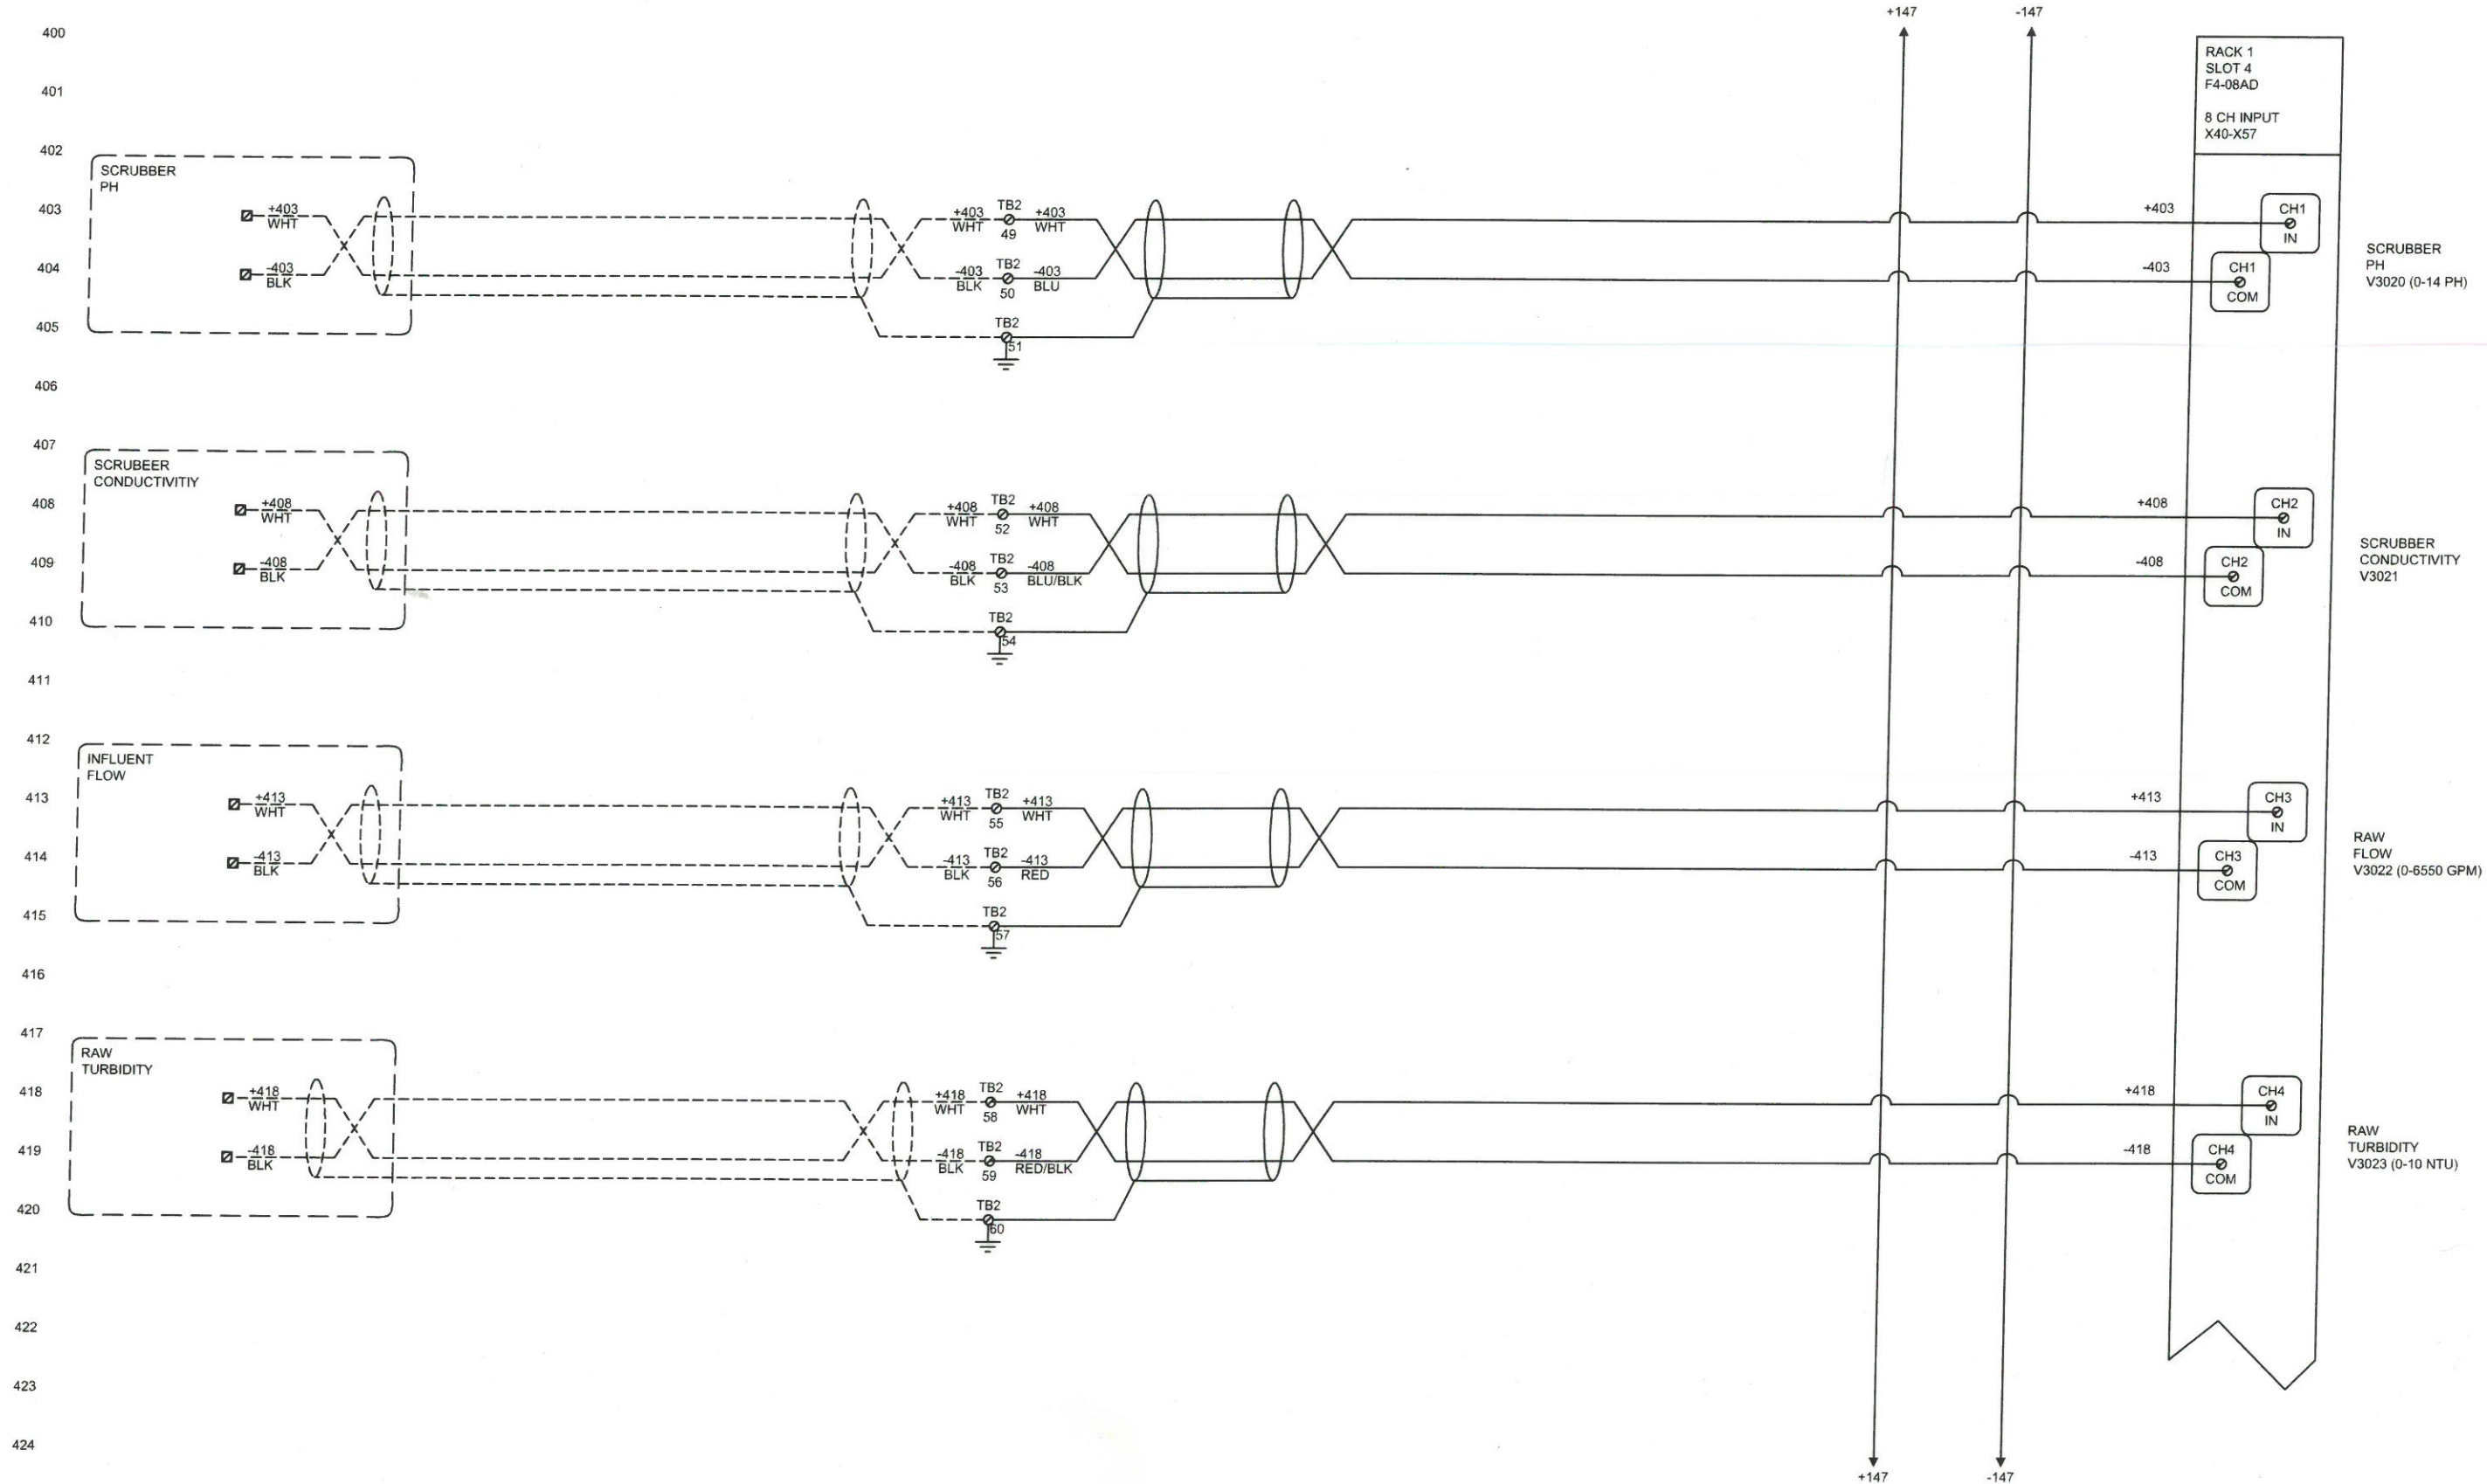

5/5/2010	FOR SUBMITTAL	PEN	
DATE	REVISION	BY	CH'D



The information, specifications and data contained in this drawing are furnished by and are to remain the property of BCI Technologies. The acceptor warrants that no use will be made of the same except to facilitate the installation, maintenance and operation of the equipment represented by said drawing.

TOLERANCES (UNLESS OTHERWISE SPECIFIED)	CUSTOMER: CITY OF MARCO ISLAND
TITLE: WATER TREATMENT PLANT IMPROVEMENTS - MAIN PLC MAIN PLC ANALOG INPUT MODULE 3 (PAGE 1 OF 2)	
SCALE: PEN	CHECKED BY: APP'D BY:
DATE: 5/5/2010	DRAWING NO. 10145-MAIN-EE-04-01

