



NOTE: UTILIZE NEMA4X JUNCTION BOXES WHERE REQUIRED TO SPLICE AND EXTEND PROBE WIRES. SPLICES SHALL UTILIZE SCOTCHCAST RE-ENTERABLE ELECTRICAL INSULATING RESINS BY 3M OR EQUAL.

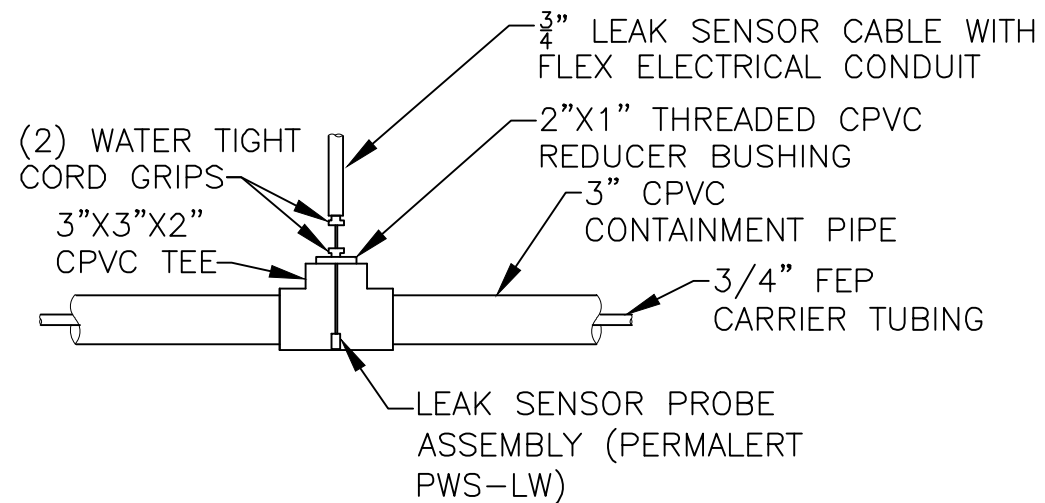

LEAK SENSOR INSTALLATION DETAIL
N.T.S.

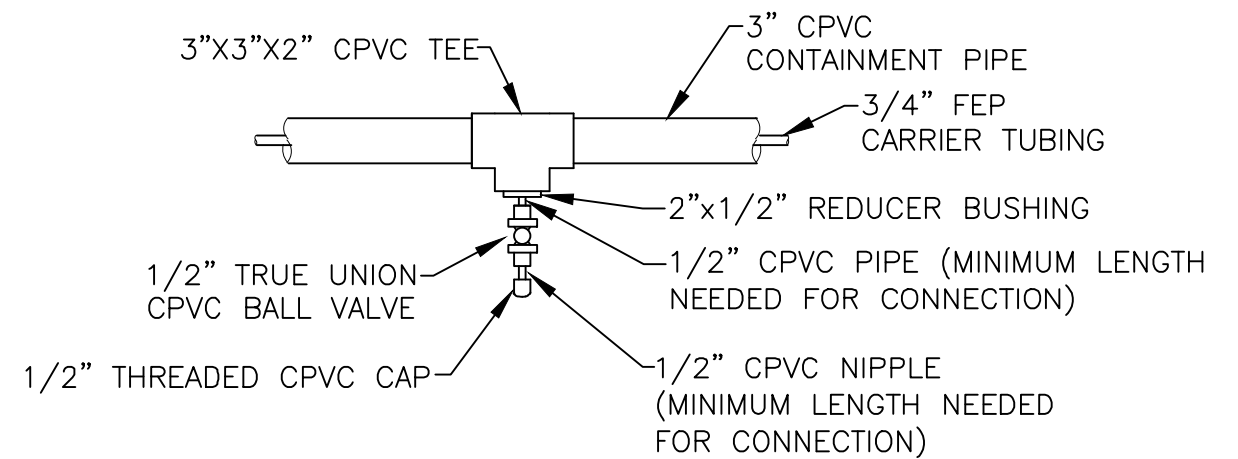

DRAIN INSTALLATION DETAIL
N.T.S.

NO.	DATE	REVISIONS	BY



950 Encore Way
Naples, FL. 34110
Phone: (239) 254-2000
Florida Certificate of
Authorization No.1772

DESIGN BY: J.M.M.
DRAWN BY: J.M.W.
CHECKED BY: D.W.S.
CAD FILE: 21038_PLAN SET

Jared M. Mellein, PE
Florida Reg. No. 89872



ISSUED FOR BIDDING

COUNTY WATER-SEWER DISTRICT
COLLIER COUNTY, FLORIDA
NORTH COUNTY WATER RECLAMATION FACILITY
NORTH & SOUTH BLEACH PIPING REPLACEMENT
ADDENDUM #1 DETAILS

PROJECT NO. :
2021.038
DATE :
06/22
SHEET NO. :
A-1