

**Date:** June 2, 2025


**To:** Interested Bidders

**From:** Matthew Fortune

**Subject:** PS 308.06 Rehabilitation

**The following changes were made to Request for Quotes – RFQ 20-7800 PS 308.06 Rehabilitation**

1. In lieu of the 6" x 6" concrete posts shown for the control /electrical equipment posts and generator receptacle post, a 6" x 6" x 0.25" aluminum post shall be utilized. The aluminum shall be coated wherever in contact with concrete. All bolting to the post shall be with stainless steel thru bolts provided with isolation washer, etc.

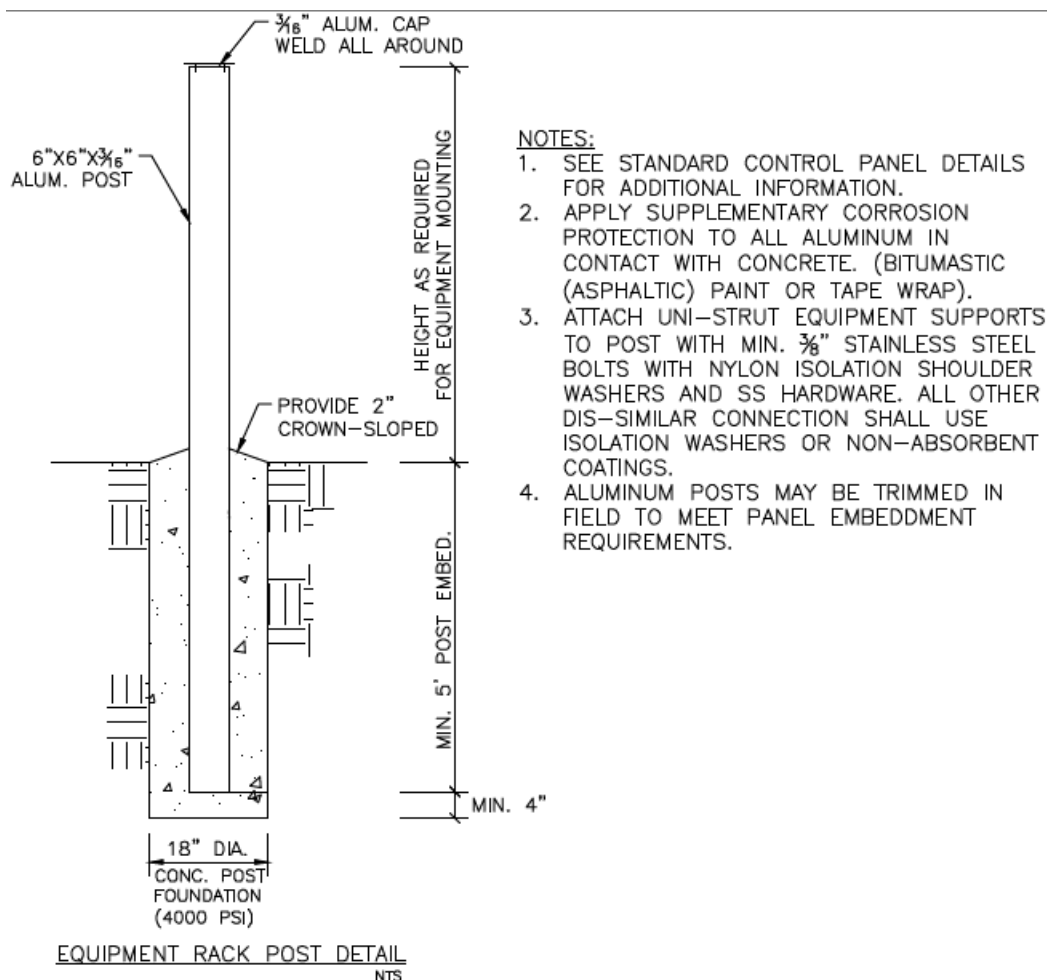

**Please sign below and return a copy of this Addendum with your submittal for the above referenced solicitation.**

\_\_\_\_\_

(Signature)

\_\_\_\_\_

Date

\_\_\_\_\_

(Name of Firm)