



**November 9, 2023**

**City of Plant City  
Procurement Department  
[cpcprocurement@plantcitygov.com](mailto:cpcprocurement@plantcitygov.com)**

**IFB 23-042UM-TG  
Lift Station 7 Replacement Project REBID**


**Addendum No. 5**

**\*Respondents are required to acknowledge this addendum in their response.**

The following is additional information, clarifications, questions, and responses related to the above referenced IFB.

**Clarifications**

- **A backup generator will not be included in this bid. The City will install a generator on site after construction is complete. The Contractor will install two 30 LF runs of 2" conduit (60 LF of 2" conduit total) with sweeps, ground protrusions, and 2" caps at the control panel and a location adjacent to the generator pad. Contractor will coordinate location adjacent to the generator pad with the City prior to installation to ensure conduit runs will align with future anticipated generator chosen for lift station site.**

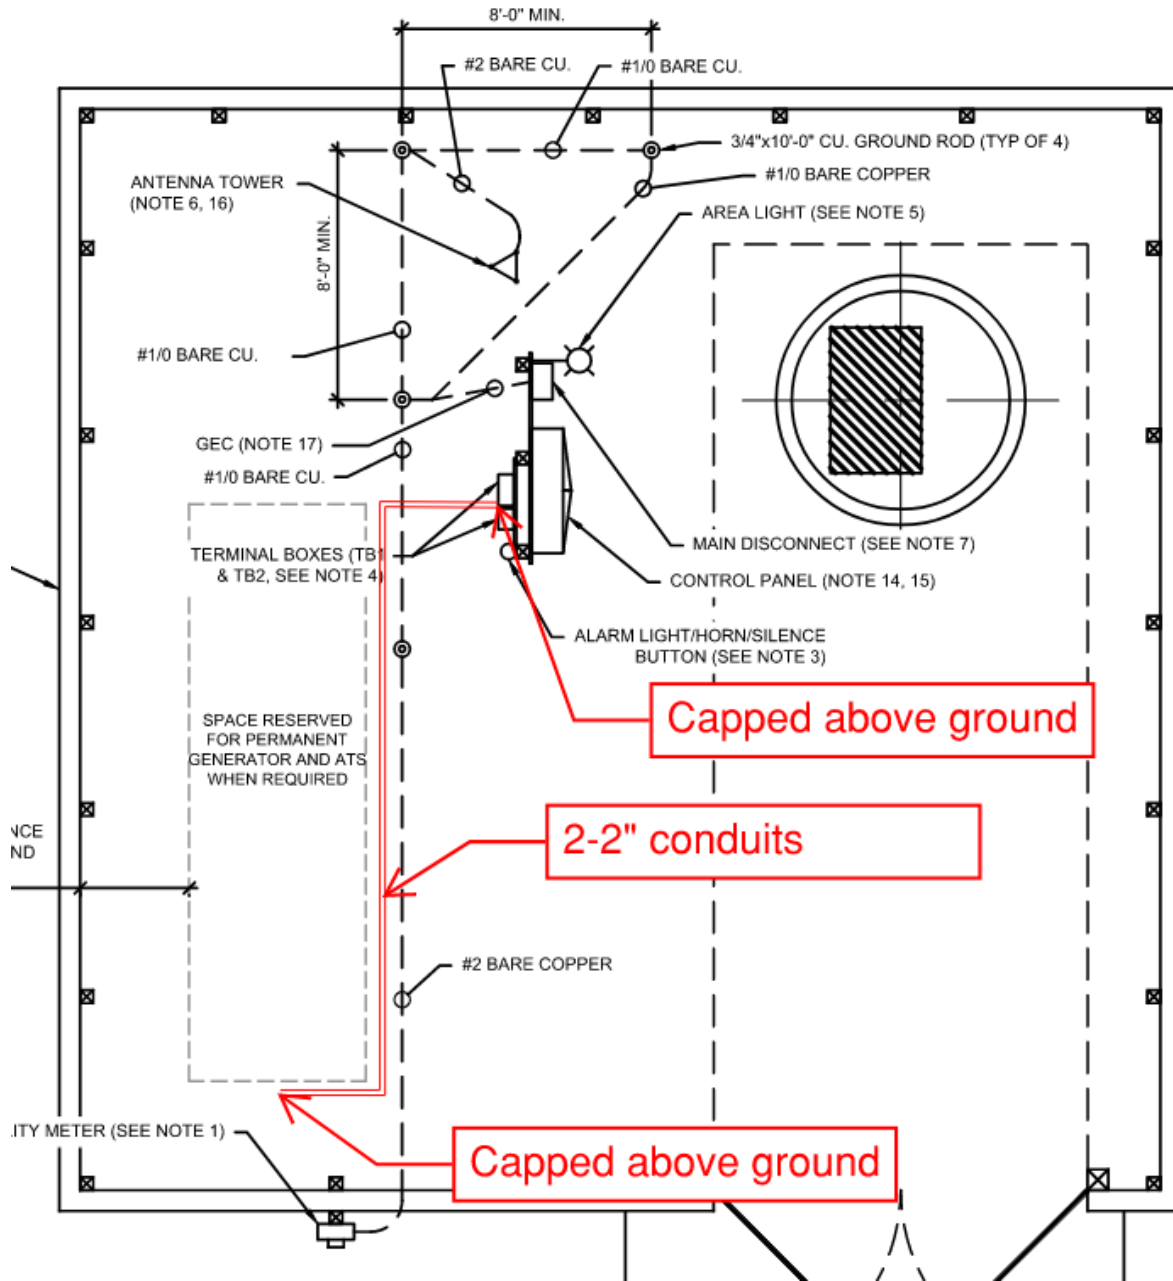

**All other requirements, terms and conditions of the IFB Document remain unchanged.**